

### Features

- 1.28 gpf (4.8 lpf).
- Activation distance is factory-set.
- Chloramine and chlorine resistance on all rubber components exposed to waterway.
- Engineered for optimal performance with KOHLER® commercial fixtures.
- No external flush volume adjustment ensures water conservation.
- 125-micron filter protects internal components.
- 24-hour automatic sentinel flush keeps trapway fresh.
- Mechanical override enables flushometer to be used manually even during a power outage.
- Powered by 1.5V AA lithium batteries.
- Less stop valve and tailpiece.

### Material

- Brass construction with durable Polished Chrome finish.

### Technology

- Electronic infrared sensor with Tripoint® technology for accurate activation.
- Patented piston technology for superior flush volume accuracy.

### Installation

- Intended for toilet installations with 1-1/2" (38 mm) top spud coupling connection.

### Recommended Products/Accessories

K-23723 Faucet cleaner

### Optional Products/Accessories

GP1118986 Flushometer Extension Kit

K-10313 Flushometer 12" rough-in kit



ADA

CSA B651

OBC

### Codes/Standards

ASME A112.18.1/CSA B125.1

ASSE 1037/ASME A112.1037/CSA B125.37

ADA

ICC/ANSI A117.1

CSA B651

OBC

### KOHLER® One-Year Limited Warranty

See website for detailed warranty information.

### Available Colors/Finishes


*Color tiles intended for reference only.*

Color	Code	Description
-------	------	-------------



CP

Polished Chrome

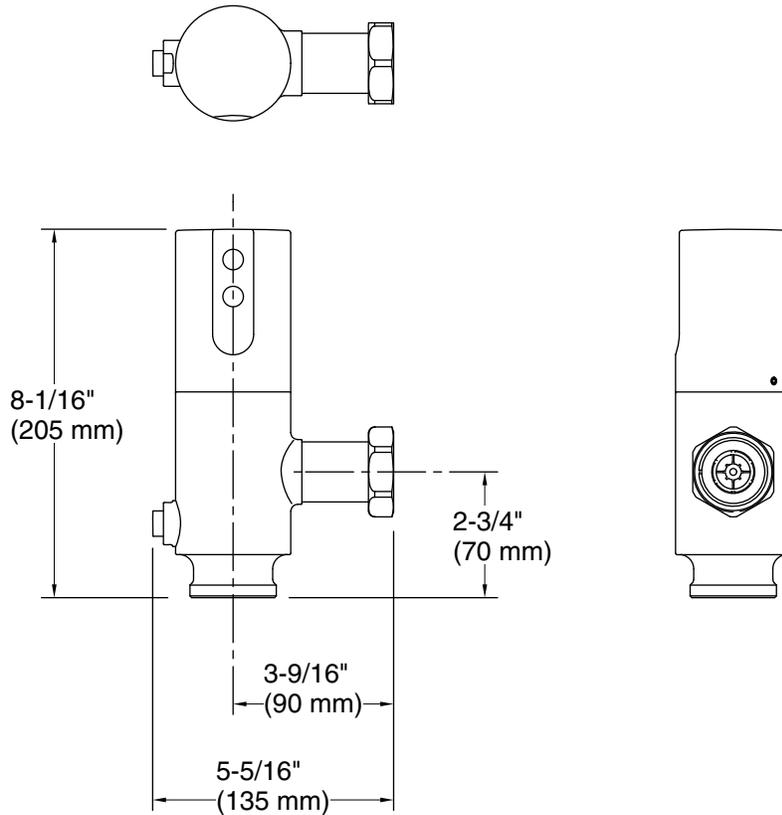

### Technical Information

All product dimensions are nominal.

Power source: Battery - DC, included

### Pressure/fixture Supply Requirements

Fixture pressure max (static): 80 psi (551.6 kPa)

Fixture pressure min (static): 35 psi (241.3 kPa)

Min flowing pressure: 25 psi (172.4 kPa)

Min flow rate: 25 gpm (94.6 lpm)

### Notes

Install this product according to the installation instructions.

ADA, OBC, CSA B651 compliant when installed to the specific requirements of these regulations.

For ADA installations, rear grab bar may need to be split or shifted.